


NEUTRIAL BAR

EARTH BAR



CONSULTANT

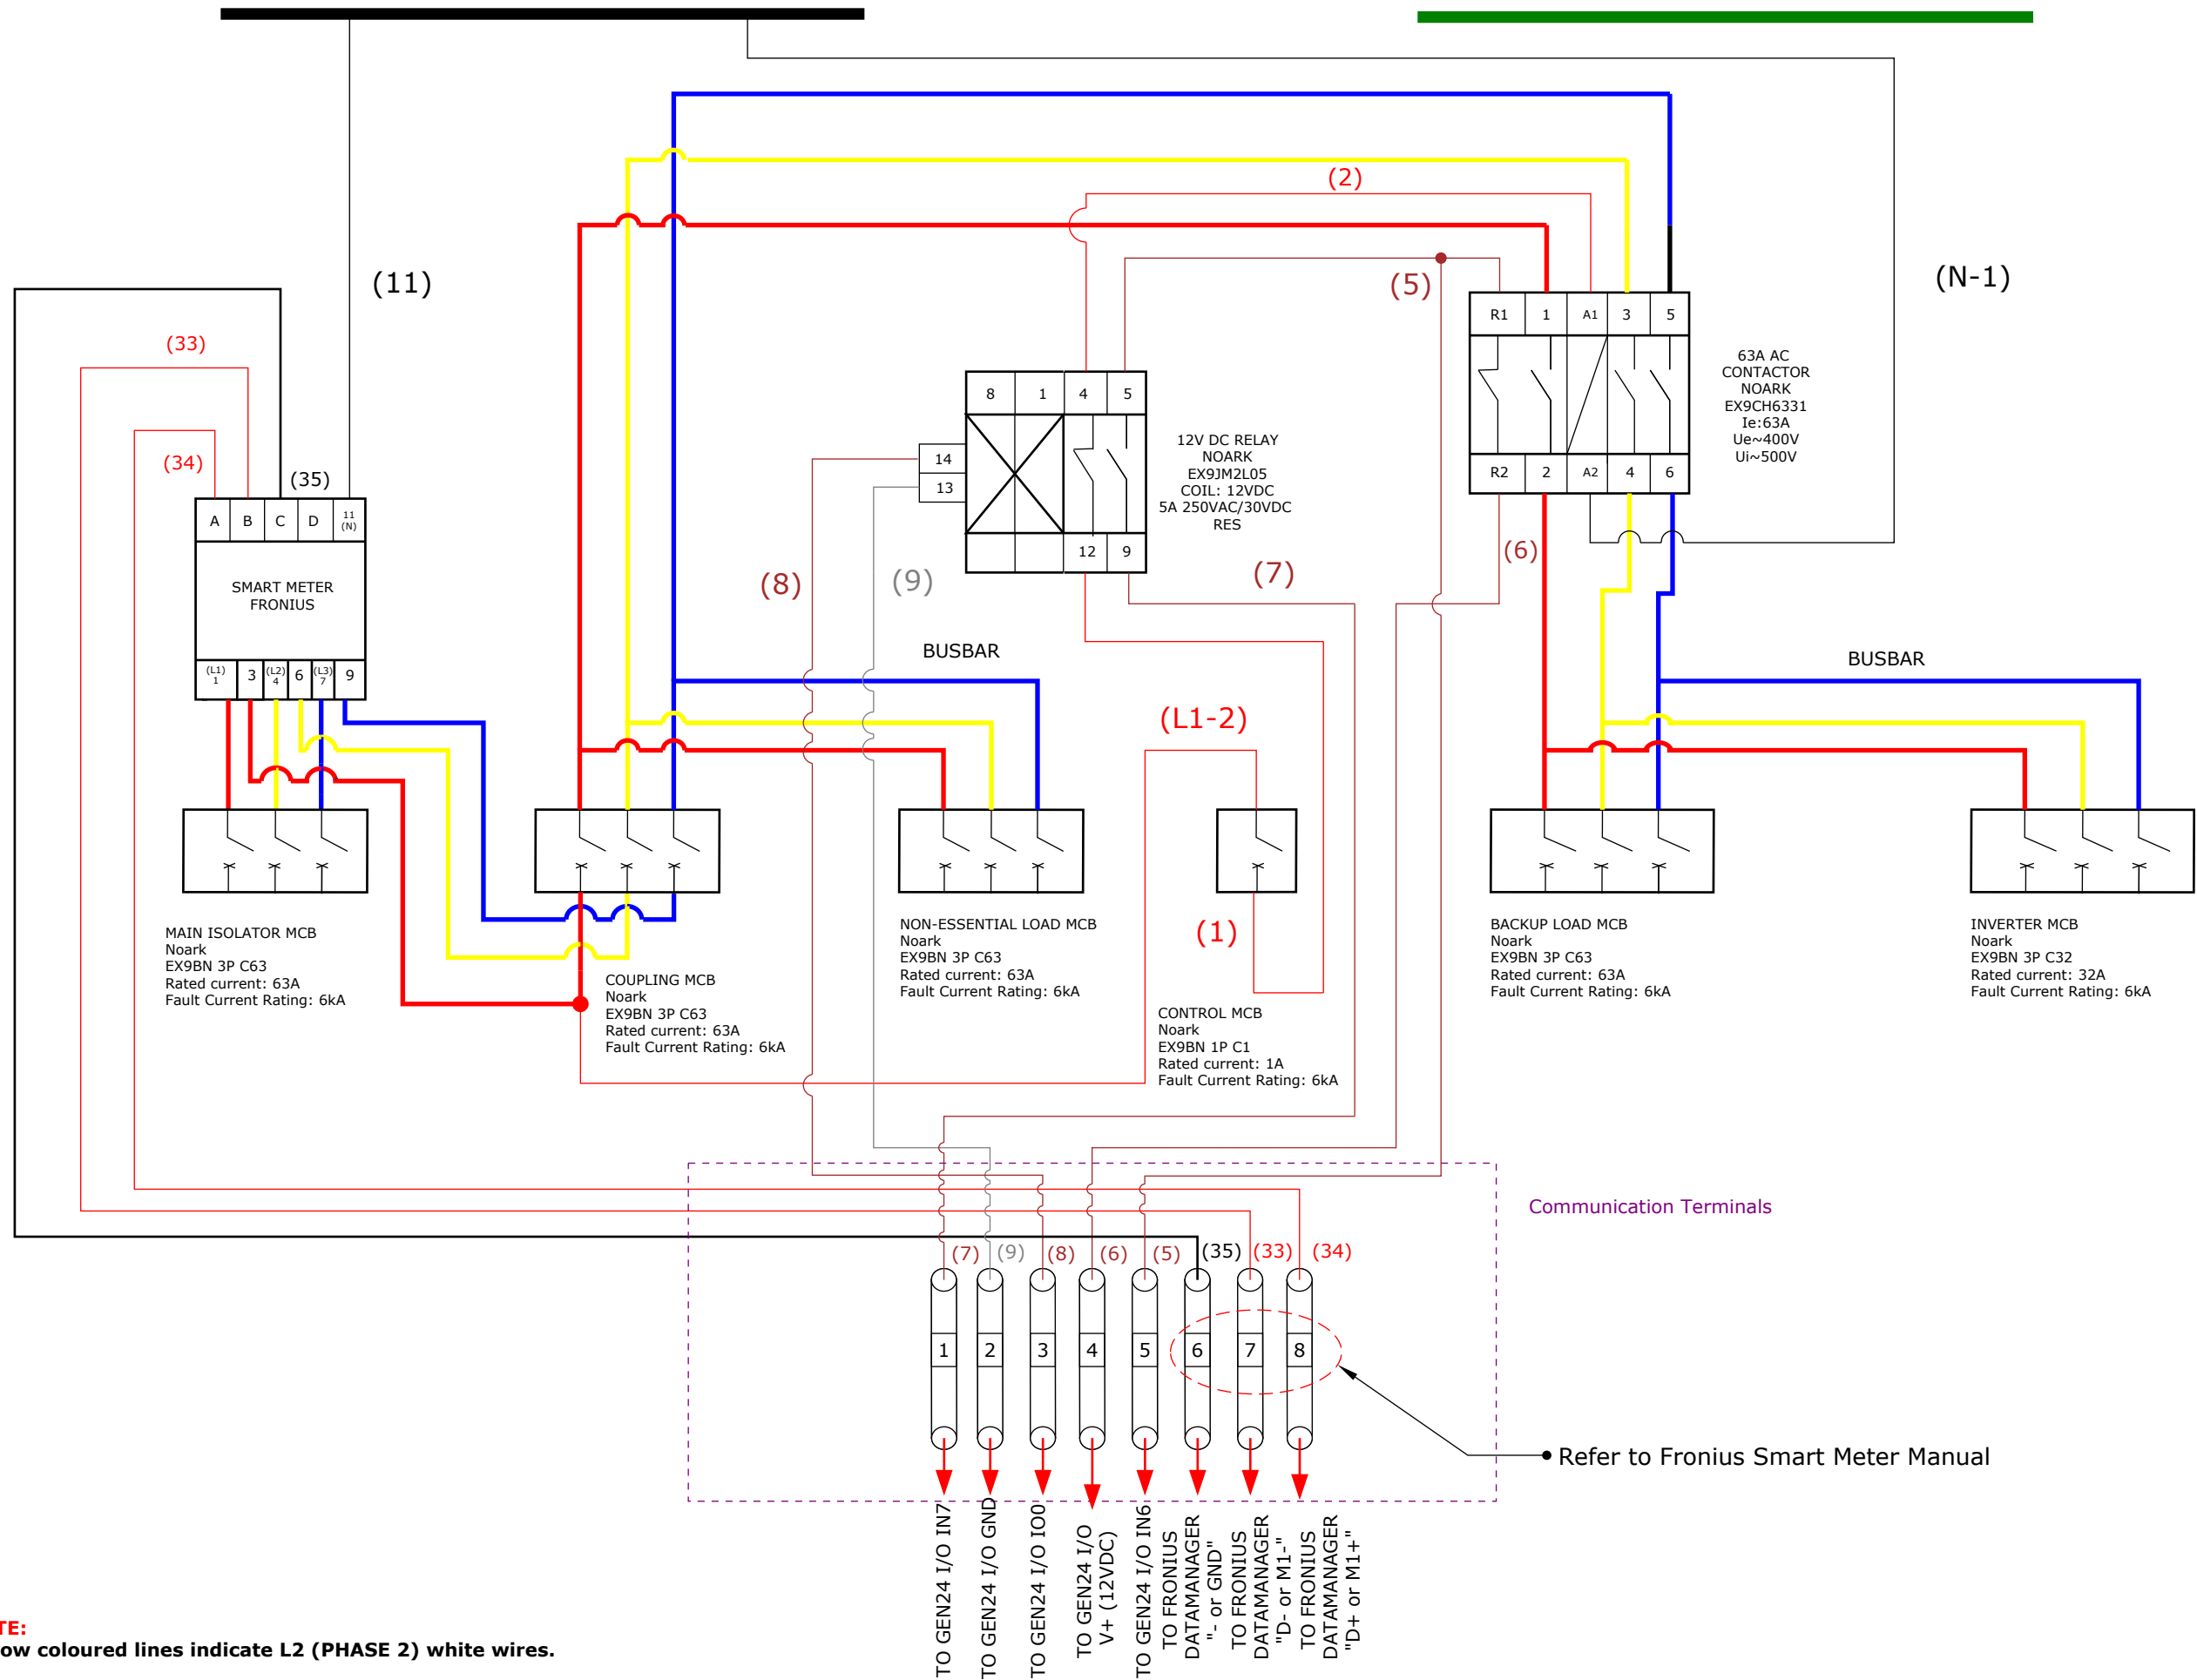

CLIENTS

DRAW BY

DK

PROJECT

SHEET TITLE

GEN24 ATS
3P

SHEET NAME

NOTES

- All works shall comply with: AS3000, AS3008, AS5033, AS4777, CEC Guidelines, Supply Authority Service & Installation Rules and local authority guidelines.
- Ensure system is labelled to AS5033, AS4777.1, CEC guidelines and relevant state requirements.
- POC design and material supply should be in line with connection agreement.

☒ FOR CONSTRUCTION
☐ PROGRESS DRAWING

REVISION	DS	APPROVAL
1		
2		
3		

REVISION

V 1.0

A3 PAGE 1